



QUEZON I ELECTRIC COOPERATIVE, INC.

Brgy. Poctol, Pitogo, Quezon

Telefax: 042-318-8156

ISC-2026-12

INVITATION FOR SEALED CANVASS

July 21, 2026

Sealed Bids/Proposals/Quotations for the Supply and Delivery of the following item for QUEZELCO 1 shall be received by the Bids and Awards Committee until 5:00PM of July 27, 2026. The bids/proposals/quotations will be opened on July 28, 2026 at 9:00AM.

No.	Quantity	Unit	Item Description	Unit Cost (Php)	Total Amount (Php)
1	18	pcs	Potential Transformer, 15kV, 70:1		
2	18	pcs	Current Transformer, 15kV, 200/100:5		
GRAND TOTAL					

Instruction to Bidder and Terms of Condition:

The following shall be included in the offer:

1. Warranty statement. The bidder obligates, guarantees and warrants that the items to be delivered are within the standards and specifications set by the cooperative. Upon completion, there will be a 2 years warranty.
2. Brochure or any document showing the technical specifications of the materials offered.
3. Authorization from the manufacturer to supply the goods valid for the current year.
4. The materials offered shall comply with the required specifications (See attached material specifications)
5. Delivery period shall be within forty five (45) to sixty (60) calendar days after receipt of Notice to Proceed.
6. The financial offer shall be listed on the space provided above.
7. The financial offer shall not exceed the Approved Budget Cost of **Php 1,756,800.00**
8. The ABC is VAT inclusive and the bid price should be VAT inclusive.
9. Term of payment : 90 calendar days after delivery completion and presentation of invoice.
10. Term of Delivery - FOB Pitogo
11. Performance Bond of 5% of contracted price shall be posted within 5 days upon receipt of notice of award.
12. Price validity - 60 calendar days
13. Penalty Clause – 1/10 of 1% (0.1%) of the cost of the unperformed portion of the contract for every day of delay)

Additional Instructions:

1. Please send your quotations thru email using the designated BAC email address **quezelco1_bac@yahoo.com.ph** and shall be addressed to "The Bids and Awards Committee".
2. The subject shall bear the word "**Bids for the Supply and Delivery of CT and PT for Installation of Feeder Metering at Substations**"
3. The quotation shall be password protected. Password shall be sent on the day of opening at 8:00 am.

QUEZELCO 1 reserves the right to reject any or all bids without offering any reason, waive any defect therein and accept the offer most advantageous to the cooperative.

For further inquiries you may contact our QUEZELCO 1 BAC Secretariat, Ms. Maria Teresa C. Capino at mobile number 09688520659.

Noted by:

VICTOR R. CADA
Acting General Manager

REYNIER I. JORDAN
BAC – Chairman

QUEZON 1 ELECTRIC COOPERATIVE, INC.
Poctol, Pitogo, Quezon

MATERIAL SPECIFICATION

POTENTIAL TRANSFORMER

Description	Potential Transformer 13.8 KV
Insulation Type/Cooling	Cast-Resin, Dry Type
Type	Single Phase, Inductive type, Single Bushing/Double bushing
Nominal System Voltage, KV	13.8 KV
Maximum Continous Voltage, KV	15 KV
BIL	100 KV at full wave crest
Frequency	60 Hz.
Post Insulator Characterestics	
1. Voltage Class, KV	15
2. Creepage length	375 minimum
Mounting	Pedestal
Service Environment	Outdoor, Heavily polluted
Compliance to Standards	ANSI/IEEE C57.13
Accuracy Class	
(at 25-100% of Rated Burden)	0.3S or Better
Minimum Burden Rating	25VA
Accuracy Range	From 90% to 110%
(Verified by test at factory)	Rated Voltage
Number of Core	Two (2)-Double Core Secondary PT
Single Ratio (L-G)	8400V:120V
Marked Ratio	70:1
Rated Secondary Voltage	120V
Termination	Line to Ground
Rated withstand and test voltage, KV	34
*Low frequency withstand, KV RMS	95
*Impulse lighting withstand, KV crest	


CURRENT TRANSFORMER

Description	Current Transformer 13.8 KV
Insulation Type/Cooling	Cast-Resin, Dry Type
Nominal System Voltage, KV	13.8 KV
Maximum Continous Voltage, KV	15 KV
BIL	75 KV at full wave crest
Frequency	60 Hz.
CT Burden	0.3B-0.5

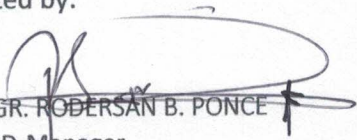
Marked Ratio	200/100 : 5 A
Rating Factor	1.5 or Higher
Service Environment	Outdoor, Heavily polluted
Compliance to Standards	ANSI/IEEE C57.13

Note: **Provided with:** Test Result
Potential and Current transformer must
be tested and sealed by ERC

Prepared by:


ENGR. JOSEPH KEVIN M. RIVADULLA
TSS Head

Noted by:


ENGR. ROBBERSON B. PONCE
OMD-Manager

QUEZON I ELECTRIC COOPERATIVE, INC.
Brgy. Pocol, Pitogo, Quezon

Accreditation Requirements

Name of Company/Supplier/Representative:
Address:
Contact Number :
EMAIL ADD:

	DOCUMENTS	
1	DTI Registration name registration or SEC Registration Certificate	
2	Valid and current Mayor's Permit/Municipal License	
3	Taxpayer's Identification Number,	
4	BIR Value Added Tax Registration	
5	Certification that the bidder is not "blacklisted" or banned from bidding by the government or any of its agencies, officers, corporation or LGU's and other private corporations or electric cooperatives	
6	Compliance with EO # 398	
	a.) Proof of VAT Payments for the past six months	
	b.) Tax Clearance for the last two quarters	
7	On-going, completed or awarded contract not yet started within the relevant period specifying the following:	
	a. Name of contract	
	b. Date of contract	
	c. Amount of the contract and value of outstanding contracts	
	d. Date of delivery	
	e.End user's acceptance if completed	
8	Company Profile	
9	Latest Income Tax Return	
10	Complete set of Audited Financial Statements, stamped "received" by the BIR or its duly accredited and authorized institutions, for the immediately preceding calendar year, showing, among others, the prospective bidder's total and current assets and liabilities	
11	Articles of Incorporation, Partnership or Cooperation, whichever is applicable	
12	A certification under oath from the bidders responsible officers that the bidders is free and clear of all liabilities with the government	
13	Valid Registration with Philippine Contractor Accreditation Board (PCAB) with specialization in electrical works and with at least small B size range Classification (C and D category)- for contractor only	

Email Address:
quezelco1_bac@yahoo.com.ph