



QUEZON I ELECTRIC COOPERATIVE, INC.

Brgy. Poctol, Pitogo, Quezon

Telefax: 042-318-8156

ISC-2026-13

INVITATION FOR SEALED CANVASS

August 5, 2026

Sealed Bids/Proposals/Quotations for the Supply and Delivery of the following item for QUEZELCO 1 shall be received by the Bids and Awards Committee until 5:00PM of August 11, 2026. The bids/proposals/quotations will be opened on August 12, 2026 at 9:00AM.

No.	Quantity	Unit	Item Description	Unit Cost (Php)	Total Amount (Php)
1	50	pcs.	Anchor, Expanding with 8 blade wedges		
2	250	pcs.	Anchor, Rod, Single Eye, 5/8" X 7', Hot Dip Galvanized, Forged		
3	200	pcs.	Bolt, Double Upset 5/8" X 14", Hot Dip Galvanized, Forged		
4	150	pcs.	Bolt, Thimble Eye 5/8" X 8", Angle Type, HDG, Forged		
5	150	pcs.	Bolt, Thimble Eye 5/8" X 10", Angle Type. HDG, Forged		
6	50	pcs.	Bolt, Thimble Eye 5/8" X 12", Straight Type, HDG, Forged		
7	100	pcs.	Bracket, Mounting for Fuse Cut-Out & Arrester		
8	230	pcs.	Bracket. Transformer Pole Mounting, 1 Phase, Hot Dip Galvanized		
9	700	pcs.	Clevis, Secondary Swinging Without Spool, Hot Dip Galvanized		
10	250	pcs.	Insulated Secondary bracket without Spool		
11	50	pcs.	Connector, Compression, YHO 125, Run #6- #1/0- Tap #6 - #2		
12	3,500	pcs.	Connector, Compression, YHO 150, Run #3 - #1/0 -Tap #6- #2		
13	180	pcs.	Crossarm, Steel, 3" X 4" X 8', Hot Dip Galvanized-Bare thickness is 3mm		
14	100	pcs.	Guy, Dead-end Grip, 7/16"		
15	1,200	pcs.	Insulator, Spool, 3", ANSI, Class 53-4		
16	700	pcs.	Nut, Eye, 5/8", Conventional, Hot Dip Galvanized		
17	400	pcs.	Steel pin long shank 5/8" x 13 3/4" x 1 3/8"		
18	250	mtrs.	Tie, Wire, Aluminum Alloy, Soft, #4 AWG (M)		
19	3,000	pcs.	Washer, 2-1/4"x2-1/4"x3/16", hole diameter suitable for 5/8" diameter bolt		
GRAND TOTAL					

Instruction to Bidder and Terms of Condition:

The following shall be included in the offer:

1. Warranty statement. The bidder obligates, guarantees and warrants that the items to be delivered are within the standards and specifications set by the cooperative. Upon completion, there will be a 1 year warranty.
2. Brochure or any document showing the technical specifications of the materials offered.
3. Authorization from the manufacturer to supply the goods valid for the current year.
4. The materials offered shall comply with the required specifications (See attached material specifications)
5. Delivery period shall be within thirty (30) calendar days after receipt of Notice to Proceed.
6. The financial offer shall be listed on the space provided above.
7. The financial offer shall not exceed the Approved Budget Cost of **Php 1,997,100.00**
8. The ABC is VAT inclusive and the bid price should be VAT inclusive.
9. Term of payment : Within ninety (90) days from the Finance Department's receipt of the complete billing documents, provided that the materials have been completely delivered and accepted.
10. Term of Delivery - FOB Pitogo
11. Performance Bond of 5% of contracted price shall be posted within 5 days upon receipt of notice of award.
12. Price validity - 60 calendar days
13. Penalty Clause – 1/10 of 1% (0.1%) of the cost of the unperformed portion of the contract for every day of delay)

Additional Instructions:


1. Please send your quotations thru email using the designated BAC email address **quezelco1_bac@yahoo.com.ph** and shall be addressed to "The Bids and Awards Committee".
2. The subject shall bear the word "**Bids for the Supply and Delivery of Pole Line Hardware for Maintenance Use of 3rd Qtr. of 2026**"
3. The quotation shall be password protected. Password shall be sent on the day of opening at 8:00 am.

QUEZELCO 1 reserves the right to reject any or all bids without offering any reason, waive any defect therein and accept the offer most advantageous to the cooperative.

For further inquiries you may contact our QUEZELCO 1 BAC Secretariat, Ms. Maria Teresa C. Capino at mobile number 09688520659.

Noted by:


VICTOR R. CADA
Acting General Manager


REYNIER I. JORDAN
BAC – Chairman

MATERIAL SPECIFICATIONS

LINE HARDWARES

- ALL HARDWARES AND CROSSARMS** must be hot-dipped galvanized and must conform with all of the following applicable standard;
 - ASTM – American Society for Testing Material
 - ANSI – American National Standard Institute
 - AISI – American Iron and Steel Institute
- INSULATORS** for 13.2/7.62-0.23kV Distribution System

Pin Type Insulator				
ANSI Class	55-3	55-5	56-1	56-2
Min. Pin Diameter, mm	121	178	191	229
Min. Pin Height, mm	95	124	146	165
Min. Saddle Groove Radius, mm	19	25.4	19	19
Min. Wire Groove Radius, mm	14	14.3	14	14
Nominal Voltage, kV	10	15	10	10
Leakage Distance, mm	178	305	330	432
Dry Arcing Distance	114	159	178	210
Cantilever Strength, kN	11.1	13.3	11	13.2
Power Frequency Dry Flashover Voltage, kV	55	80	95	110
Power Frequency Wet Flashover Voltage, kV	30	45	60	70
Test Voltage to Ground	10	15	15	22


Suspension Insulator				
ANSI Class		52-1	52-3	52-4
Shell Diameter, mm		152	292	292
Nominal Voltage, kV		10	10	10
Leakage Distance, mm		178	292	292
Combined M&E Strength, kN		44	88	88
Tension Proof Load, kN		22	44	44
Low Frequency Flashover Voltage, kV	Dry	60	80	80
	Wet	30	50	50
Critical Impulse Flashover Voltage, kV	Positive	100	125	125
	Negative	100	130	130
Test Voltage to Ground, kV		10	10	10

Spool Insulator				
ANSI Class	53-1	53-2	53-3	53-4
Diameter, mm	57	79	76	104
Height, mm	54	76	81	76
Neck Diameter, mm	45	45	45	73
Wire Groove Radius, mm	11	18	11	15
Transverse Strength, kN	8.9	13.3	17.8	20
Power Frequency Dry Flashover Voltage, kV	20	25	25	25
Power Frequency Wet Flashover Voltage, Vertical, kV	8	12	12	12
Power Frequency Dry Flashover Voltage, Horizontal, kV	10	15	15	15

3. CONCRETE ANCHOR BLOCK:

Length		Min. Break Load	Outside Diameter		Wall Thickness	Weight (approx.)
Meter	Feet (approx.)	kgs.	mm.	Inches (approx.)	mm.	kgs.
0.90	3	4,000	150	6	42	30
1.20	4	5,000	200	8	42	60

4. POLE CLAMP (10" dia.) for Diagonal Brace

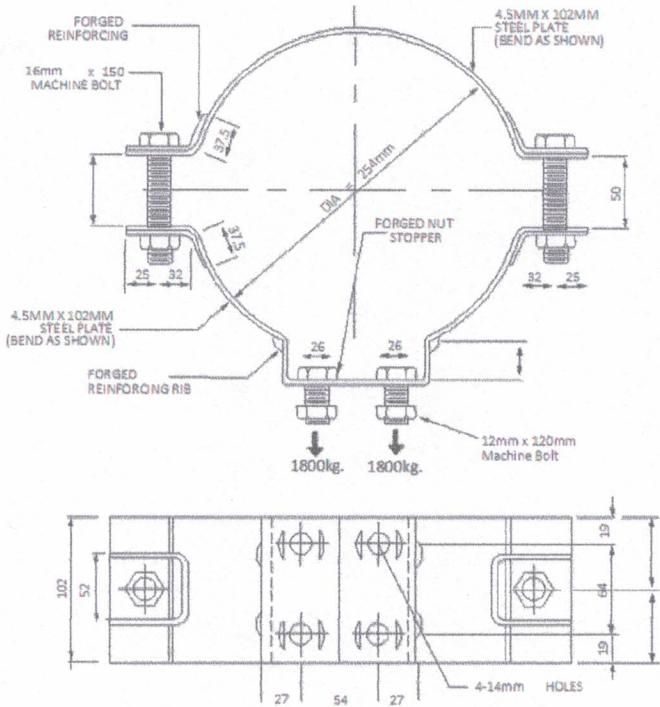

Prepared by:

ENGR. JENNIE LYN JIMENA
Line Rehabilitation Section, Head

Checked by:

ENGR. GERALD P. BAUTISTA
Engineering Department Manager

QUEZON I ELECTRIC COOPERATIVE, INC.
Brgy. Pocol, Pitogo, Quezon

Accreditation Requirements

Name of Company/Supplier/Representative:
Address:
Contact Number :
EMAIL ADD:

	DOCUMENTS	
1	DTI Registration name registration or SEC Registration Certificate	
2	Valid and current Mayor's Permit/Municipal License	
3	Taxpayer's Identification Number,	
4	BIR Value Added Tax Registration	
5	Certification that the bidder is not "blacklisted" or banned from bidding by the government or any of its agencies, officers, corporation or LGU's and other private corporations or electric cooperatives	
6	Compliance with EO # 398	
	a.) Proof of VAT Payments for the past six months	
	b.) Tax Clearance for the last two quarters	
7	On-going, completed or awarded contract not yet started within the relevant period specifying the following:	
	a. Name of contract	
	b. Date of contract	
	c. Amount of the contract and value of outstanding contracts	
	d. Date of delivery	
	e. End user's acceptance if completed	
8	Company Profile	
9	Latest Income Tax Return	
10	Complete set of Audited Financial Statements, stamped "received" by the BIR or its duly accredited and authorized institutions, for the immediately preceding calendar year, showing, among others, the prospective bidder's total and current assets and liabilities	
11	Articles of Incorporation, Partnership or Cooperation, whichever is applicable	
12	A certification under oath from the bidders responsible officers that the bidders is free and clear of all liabilities with the government	
13	Valid Registration with Philippine Contractor Accreditation Board (PCAB) with specialization in electrical works and with at least small B size range Classification (C and D category)- for contractor only	

Email Address:
quezelco1_bac@yahoo.com.ph